


FUSIBLE LINKS: 450 DEG F



REMOTE PULL STATION



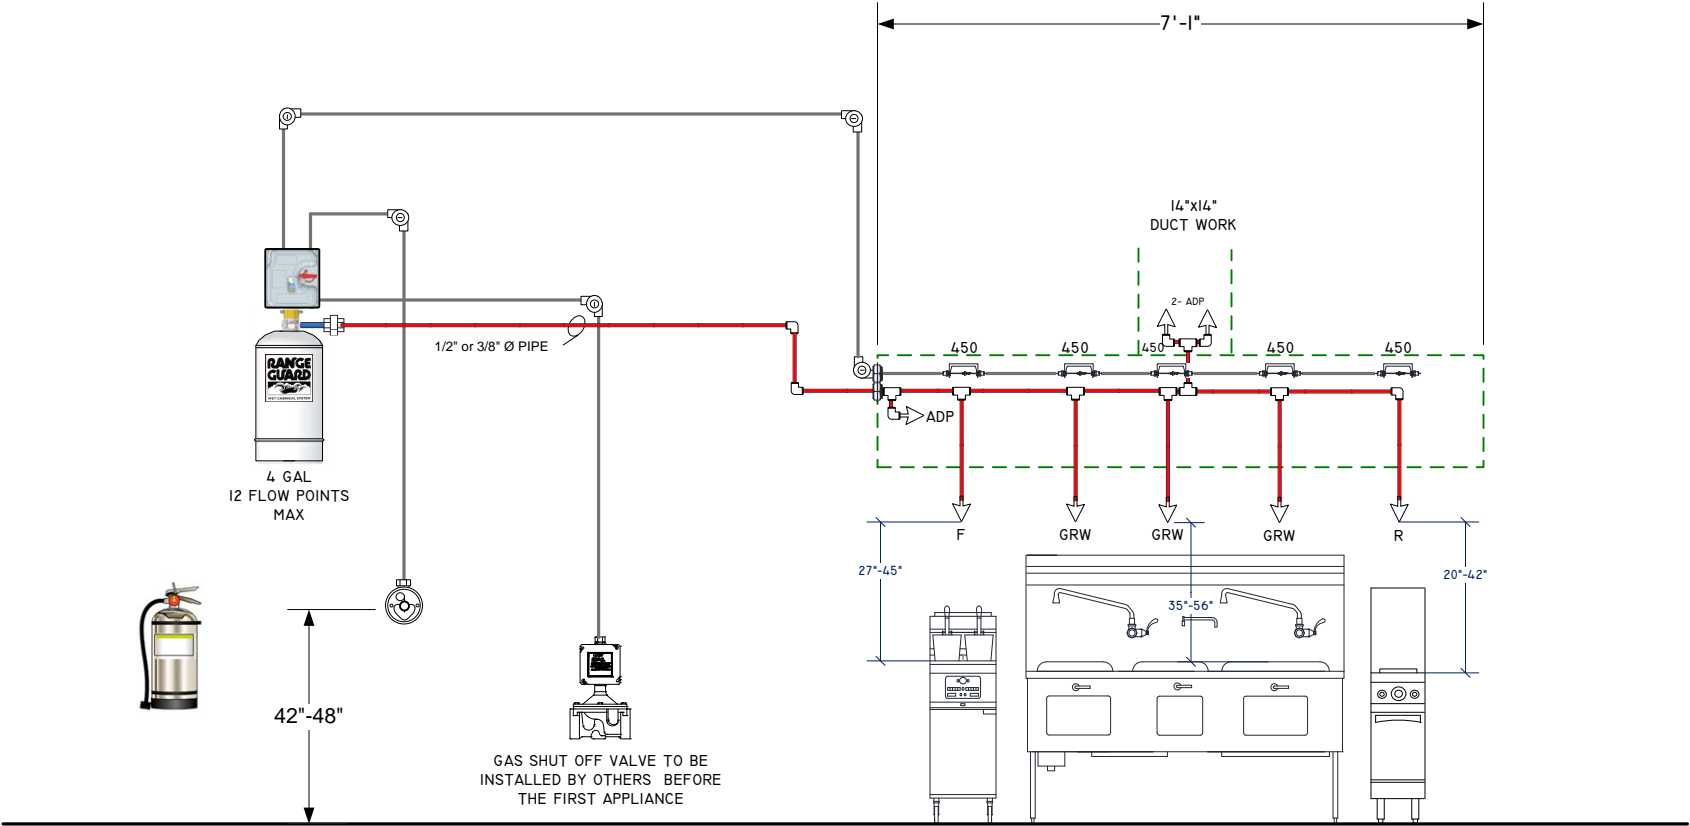

SHALL BE INSTALLED 42" - 48" ABOVE THE FINISHED FLOOR AND A DISTANCE OF AT LEAST 10FT FROM THE HAZARD BUT NOT MORE THAN 20FT. IT SHALL BE INSTALLED IN THE PATH OF EXIT AND REQUIRE A MAXIMUM FORCE OF 40 LBS AND A MAXIMUM MOVEMENT OF 14" FOR ACTUATION

CLASS K WET CHEMICAL EXTINGUISHER

SHALL BE INSTALLED 42" - 48" ABOVE THE FINISHED FLOOR

RANGE GUARD 4 GALLON SYSTEM
THIS SYSTEM USES 9 OF 12 FLOW POINTS

PRE-ENGINEERED SYSTEM SHOP DRAWING ONLY – NOT TO SCALE

PIPE SIZES	
	3/8" Ø PIPE
	1/2" Ø PIPE
	3/4" Ø PIPE
	1" Ø PIPE



					GREASE DUCKS 200 – 100 PARK ROYAL WEST VANCOUVER BC V7T 1A2			
					BEE THAI COUSINE 33261 I AVE MISSION BC V2V 1G7			
	SIZE	DWG NO.	DWG		KITCHEN FIRE SYSTEM		REV	1
	SCALE	N/A	12/12/2018	SHEET	1 OF 4			

GENERAL NOTES:

1. SYSTEM SHALL BE PRE-ENGINEERED
2. SYSTEM SHALL BE MANUFACTURED BY RANGE GUARD
3. RANGE GUARD FIRE SYSTEMS HAVE THE FOLLOWING LISTINGS AND APPROVALS:

UNDERWRITERS LABORATORIES INC, UL 300 – UL EX 2458 /ULC EX 3559
4. SYSTEM TEMPERATURE LIMITATIONS – 32F MIN / 120F MAX
5. INSTALLATION REQUIREMENTS, NOZZLE LIMITATIONS AND DESIGN CRITERIA SHALL COMPLY WITH THE TECHNICAL MANUAL AND ALL ADDENDUMS AS PUBLISHED BY RANGE GUARD
6. PIPE AND FITTINGS SHALL BE SCHEDULE 40 BLACK, CHROME PLATED OR STAINLESS. GALVANIZED PIPE SHALL NOT BE USED.
7. ALL REQUIRED ELECTRICAL WORK SHALL BE PERFORMED BY OTHERS AND IS NOT INCLUDED ON THIS SHOP DRAWING.
8. ALL REQUIRED PLUMBING WORK BE PERFORMED BY OTHERS AND IS NOT INCLUDED ON THIS SHOP DRAWING

PIPING REQUIREMENTS

Range Guard systems do not require balanced piping to achieve proper distribution of wet chemical to all nozzles. Balanced piping is not necessary because a liquid has no difficulty in turning corners or changing directions. Range Guard nozzles come equipped with permanent predetermined orifices. This means that the liquid will be delivered in the exact quantities necessary to the duct, plenum and appliance hazards as required.

All pipe shall be schedule 40 (standard weight) black steel. Pipe may be chrome plated. Galvanized pipe shall not be used. All pipe and fittings must be made tight without pipe dope or thread sealant.


Pipe fittings shall be standard weight steel, cast iron, malleable iron or ductile iron. Galvanized fittings shall not be used. Branch line connection and individual nozzle connections may be made by using either the outlet or the run of a tee.

General Rules

- A maximum of 100 equivalent ft. (30.5 m) but not more than 40 linear ft. (12.2 m) of 1/4-in. pipe may be used from each branch line.
- The highest point of the system shall not exceed 12 ft. (3.7 m) above the cylinder outlet.
- The vertical rise of a branch line above the supply line shall not exceed a maximum of 4 ft. (1.2 m).
- Maximum discharge pipe volume limitations shall not be exceeded.
- Maximum equivalent length limitations shall not be exceeded.
- Maximum flow points for a given pipe shall not be exceeded.
- There are to be no low points or “traps” present in discharge piping.

Flow Number Range			
Flow Number Range	Minimum Pipe Size	Size	Piping Discharge Line Volume
1 – 2	1/4-inch	1/4 in.	1.25 in. ³ per linear foot – (67.2 cm ³ per linear meter)
1 – 8	3/8-inch	3/8 in.	2.29 in. ³ per linear foot – (123.1 cm ³ per linear meter)
1 – 12	1/2-inch	1/2 in.	3.65 in. ³ per linear foot– (196.2 cm ³ per linear meter)
13 – 24	3/4-inch	3/4 in.	6.40 in. ³ per linear foot – (344.1 cm ³ per linear meter)
25 – 48	1-inch	1 in.	10.37 in. ³ per linear foot – (557.5 cm ³ per linear meter)

Nozzle Type	Part Number	Flow Number	Grooves	
ADP Nozzle	B120011	1	1	
F Nozzle	B120012	2	2	
GRW Nozzle	B120013	1	3	
R Nozzle	B120014	1	4	
DM Nozzle	B120015	3	0	
LPF Nozzle	B120022	2	1 & 4	
LPR Nozzle	B120024	1	Disc & Core	



1/2-INCH VENT PLUG, P/N 60-9196984-000

The 1/2-inch vent plug has a 1/2-inch (13 mm) NPT and can be installed in the outlet or the run of the tee in the discharge pipe. In all systems requiring multiple cylinder systems, only one vent plug is required. The vent plug must always point up or horizontally, never down, to assure that it will remain open during discharge.

Note: It is necessary to use a bushing with the vent plug when installing the vent plug in a tee larger than 1/2-inch (13 mm).

	GREASE DUCKS 200 – 100 PARK ROYAL WEST VANCOUVER BC V7T 1A2			
	BEE THAI COUSINE 33261 I AVE MISSION BC V2V IG7			
	SIZE	DWG NO.	DWG	REV
			KITCHEN FIRE SYSTEM	1
	SCALE	N/A	12/12/2018	SHEET 2 OF 4

3-6.1.1 DUCTS

The ADP nozzle, P/N B120011, is used for protection of the exhaust ductwork.


The duct cross section can be any shape, not including obstructions (i.e., round, square, or rectangular) and the duct itself can be of unlimited length. In accordance with NFPA 96, the exhaust fan should be left running at the time of system discharge. This will help to remove smoke and other airborne materials and gases from the hazard area in the event of a fire. Check with the Authority Having Jurisdiction for local requirements. A damper, if present, should be left open at system discharge. However, if the damper is closed, the system designer must insure that additional nozzles are required.

3-6.1.1.1 Protection of Ducts 0 to 50 inches in Perimeter

One ADP nozzle, P/N B120011, is required for protection of a duct with a perimeter up to 50-inches (refer to Figure 3-29). Length of duct is unlimited.

The nozzle is located at the geometric center of the cross-sectional area that it is protecting, and is located in the duct within six inches of the entrance.

Note: All Range Guard systems are listed by UL and ULC for use with the exhaust fan either on or off when the system is discharged.

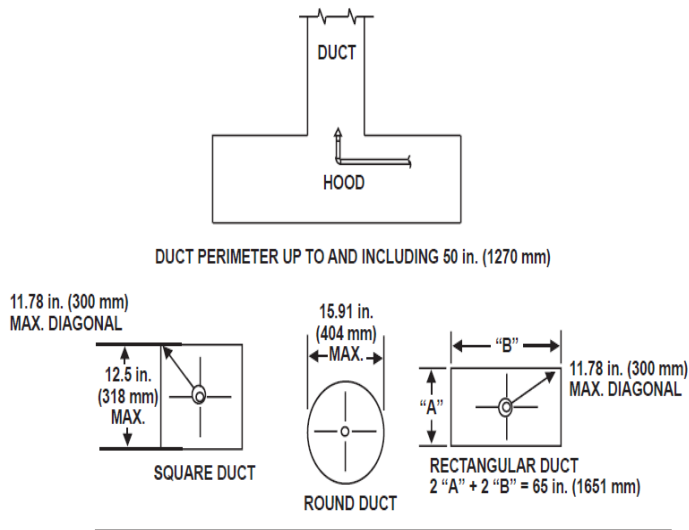

3-6.1 Plenums

Table 3-29. Plenum Protection



Items	Parameters	ADP Nozzle
No Filter ¹	10 ft. x 4 ft. (3 m x 1.2 m) Max.	1 - located at one end of the plenum
"V" Filter	10 ft. x 4 ft. (3 m x 1.2 m) 20 ft. x 4 ft. (6 m x 1.2 m)	1 - located at one end of the plenum 2 - located at end of plenum pointing inwards
Single Bank Filter	10 ft. x 4 ft. (3 m x 1.2 m) 20 ft. x 4 ft. (6 m x 1.2 m)	1 - located at one end of the plenum 2 - located at end of plenum pointing inwards

¹ When no filters are present, the nozzle protecting the plenum is used to discharge the wet chemical on the under-side of the hood. In this case, the hood may not exceed a length of 10 ft. (3 m) or a width of 4 ft (1.2 m).

Longer plenums may be similarly protected with a single ADP nozzle being used for each 10 ft. (3.0 m) of plenum length and each 4 ft. (1.2 m) of plenum width.

ADP nozzles may be used in combinations (see Figure 3-28). Multiples may be installed facing in the same direction, and/or at the ends of the plenum pointing in. Each nozzle shall provide a maximum of 10 ft. (3 m) of coverage.

ADP nozzles must be centrally located in the plenum with their discharge directed along the length of the plenum and located in relation to the filters as shown in Figure 3-28. Refer to Figure 3-28 for filter height.

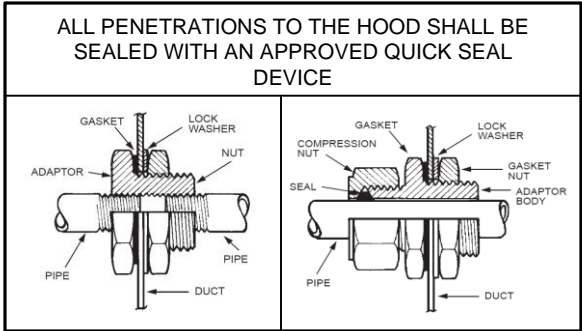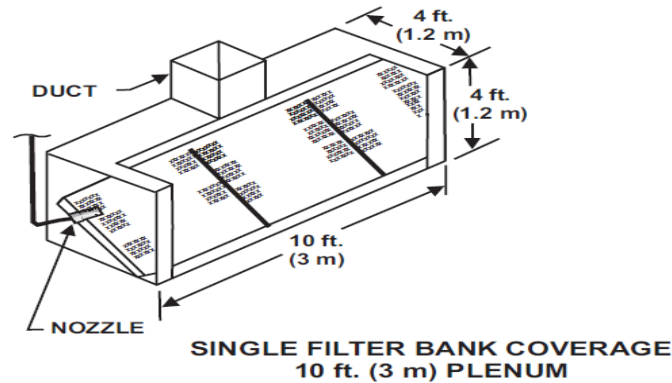

GREASE DUCKS 200 – 100 PARK ROYAL WEST VANCOUVER BC V7T 1A2				
BEE THAI COUSINE 33261 I AVE MISSION BC V2V IG7				
	SIZE	DWG NO.	DWG	REV
			KITCHEN FIRE SYSTEM	1
	SCALE	N/A	12/12/2018	SHEET 3 OF 4

3-4.1 Single Vat Deep Fat Fryer With Drip Boards

Table 3-2. F Nozzle Coverage Area

Items	Parameters
Maximum Hazard Area	18 in. x 18 in. (457 mm x 457 mm)
Maximum Appliance Area (with drip board)	18 in. x 23 in. (457 mm x 584 mm)
Nozzle Aim	Midpoint of hazard area
Nozzle Location (from top of appliance at an angle of 45° or more from the horizontal)	27 in. (686 mm) Min. 45 in. (1143 mm) Max.

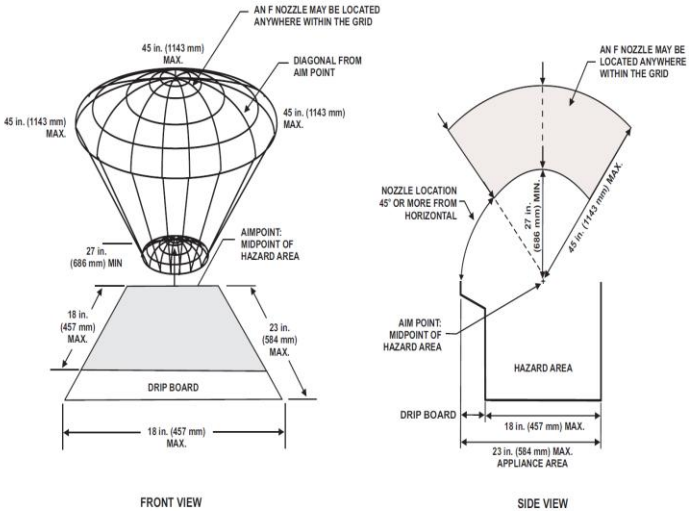


Figure 3-2. Single Vat Deep Fat Fryer

3-4.21 Wok

Table 3-27. GRW Nozzle Coverage Area

Items	Parameters
Wok Diameter	14 in. to 28 in. (356 mm to 1829 mm)
Wok Depth	3 in. to 8 in. (76 mm to 508 mm)
Nozzle Aim	Center of Wok
Nozzle Location — Must be over center and within 2 in. (51 mm) from center and nozzle height must be measured over center and within 2 in. (51 mm) from center from inside bottom of Wok. Only one nozzle per Wok.	35 in. (889 mm) Min. 56 in. (1422 mm) Max.

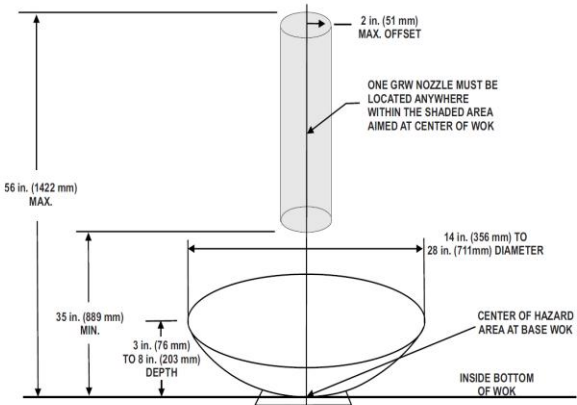



Figure 3-23. Wok

3-4.10 Two Burner Ranges

Table 3-14. R Nozzle Coverage Area — Two Burner Range

Items	Parameters
Maximum Hazard Length	28 in. (711 mm)
Nozzle Aim	Midpoint of hazard area
Nozzle Location - Anywhere within the area of a circle generated by a 9 in. (229 mm) radius about the midpoint	20 in. (508 mm) Min. 42 in. (1067 mm) Max.

Note: Shape of burner not important.

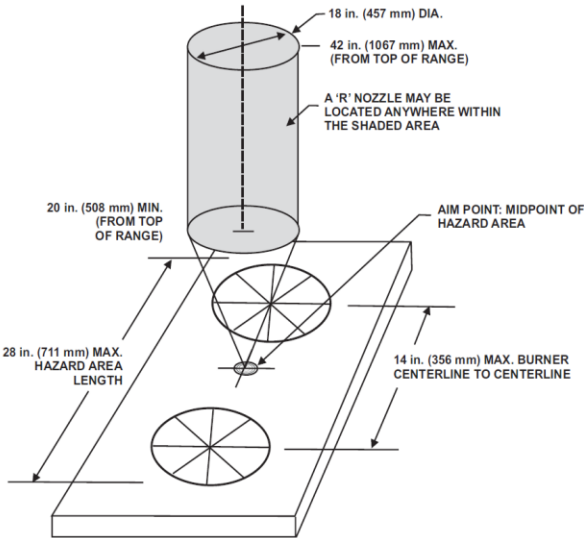

	GREASE DUCKS 200 – 100 PARK ROYAL WEST VANCOUVER BC V7T 1A2			
	BEE THAI COUSINE 33261 I AVE MISSION BC V2V 1G7			
	SIZE	DWG NO.	DWG	REV
			KITCHEN FIRE SYSTEM	1
	SCALE	N/A	12/12/2018	SHEET 4 OF 4